
## G225S-K, 2-Way, Globe Valve, Stainless Steel Trim







chilled or hot water, up to 60% glycol,
steam
modified equal percentage
stem up - open A – AB
1" [25]
NPT female ends
Bronze
316 stainless steel
EPDM O-ring
Stainless steel AISI 316
316 stainless steel
ANSI Class 250, up to 400 psi below 150°F
250
100 psi [690 kPa]
50 psi [345 kPa]
50 psi (345 kPa)
100:1
10
3.5 lb [1.6 kg]
20338°F [-7170°C]
ANSI Class VI
repack kits available

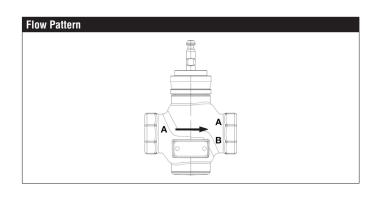


### **Application**

This valve is typically used in air handling units on heating or cooling coils, and fan coil unit heating or cooling coils. Some other common applications include unit ventilators, VAV box re-heat coils and bypass loops. This valve is suitable for use in hydronic systems with variable flow. Bronze and stainless steel trim valves can be used for steam applications, depending on actuator and close-off combinations.

**Suitable Actuators** 

	Non-Spring	Spring	Electronic fail-safe				
G225S-K	LVB(X)	LF	LVKB(X)				

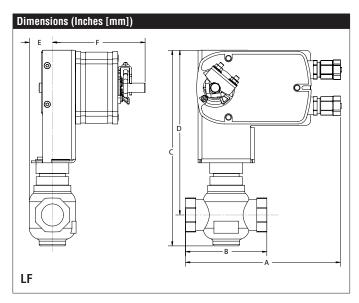

A	В	С	D	Е	F
8.3" [211]	4.4" [112]	9.5" [241]	7.6" [194]	1.2" [30]	4.9" [125]


#### Safety Notes


⚠ WARNING: For Belimo Products sold in California, these Products do or may contain chemicals which are known to the State of California to cause cancer and or birth defects or other reproductive harms. For more information see www.p65warnings.ca.gov.


#### Piping

The valves should be mounted in a weather-protected area in a location that is within the ambient limits of the actuator. Allow sufficient room for valve with actuator and for service. The G2 and G3 preferred mounting position of the valve is with the valve stem vertical above the valve body, for maximum life. However, the assemblies can be mounted with the valve stem vertical or horizontal in relation to the pipe. The actuators should never be mounted underneath the valve, as condensation can build up and result in a failure of the actuators.

# G225S-K, 2-Way, Globe Valve, Stainless Steel Trim

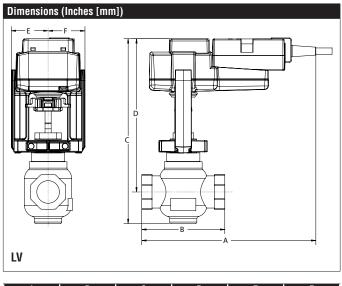



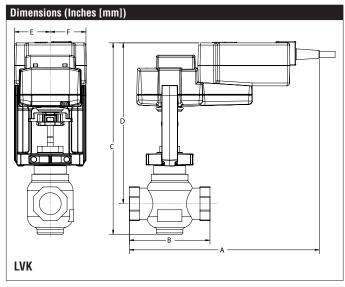

## LF120 US, Valve Actuator On/Off, Spring Return Fail-Safe, 120 VAC







	REG. EQUIP.
Technical Data	
Power Supply	120 VAC, ±10%, 50/60 Hz
Power consumption in operation	5.5 W
Power consumption in rest	3.5 W
position	
Transformer sizing	7.5 VA
Electrical Connection	18 GA appliance cable, 3 ft [1 m], with 1/2"
	conduit connector
Overload Protection	electronic throughout 0° to 95° rotation
Angle of rotation	90°
Direction of rotation motor	reversible with built-in switch
Direction of motion fail-safe	reversible with CW/CCW mounting
Position indication	Mechanical
Running Time (Motor)	4075 s
Running time fail-safe	<pre>&lt;25 s @ -4122°F [-2050°C], &lt;60 s @</pre>
A contribute to considity.	-22°F [-30°C]
Ambient humidity	max. 95% r.H., non-condensing
Ambient temperature	-22122°F [-3050°C]
Storage temperature	-40176°F [-4080°C]
Degree of Protection	IP54, NEMA 2
Agency Listing	cULus acc. To UL 873 and CAN/CSA C22.2
	No. 24-93
Noise level, motor	50 dB(A)
Noise level, fail-safe	62 dB(A)
Maintenance	maintenance-free
Quality Standard	ISO 9001
Weight	3.4 lbs (1.54 kg.)

†Rated Impulse Voltage 800V, Type of action 1.AA, Control Pollution Degree 3

## Safety Notes

△ WARNING: For Belimo Products sold in California, these Products do or may contain chemicals which are known to the State of California to cause cancer and or birth defects or other reproductive harms. For more information see www.p65warnings.ca.gov.



# LF120 US, Valve Actuator

On/Off, Spring Return Fail-Safe, 120 VAC

### Wiring Diagrams



## X INSTALLATION NOTES



Actuators with appliance cables are numbered.



Provide overload protection and disconnect as required.



Actuators may be connected in parallel if not mechanically linked. Power consumption and input impedance must be observed.



Meets cULus requirements without the need of an electrical ground connection.



### WARNING! LIVE ELECTRICAL COMPONENTS!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

